



Toase-eh Park Sanati Gohar Ofogh
Petrochemical Co.
**CONCEPTUAL, BASIC and DETAIL DESIGN
ENGINEERING OF STYRENE PARK OFFSITE**



Document Title: Compressor Test Procedure

Document No.: EI027-HSE-VD – QC– PRO– 003- R1

Rev. R1

Page 1 of 35

STYRENE PARK OFFSITE

Document Title:
Compressor Test Procedure

Rev.	Issued Date	DESCRIPTION	PREPARED	CHECKED	APPROVED
R1	20-07-2025	FI	F.sh	M.O	A.M
R0	15-05-2024	IFA	F.sh	M.O	A.M



Toase-eh Park Sanati Gohar Ofogh
Petrochemical Co.
**CONCEPTUAL, BASIC and DETAIL DESIGN
ENGINEERING OF STYRENE PARK OFFSITE**



Document Title: Compressor Test Procedure

Document No.: EI027-HSE-VD – QC– PRO– 003- R1

Rev. R1

Page 2 of 35

REVISION RECORD SHEET

Page Page	Revisions							Page	Revisions						
	R0	R1	R2	R3	R4	R5	R6		R0	R1	R2	R3	R4	R5	R6
1	X	X						41							
2	X	X						42							
3	X	X						43							
4	X	X						44							
5	X	X						45							
6	X	X						46							
7	X	X						47							
8	X	X						48							
9	X	X						49							
10	X	X						50							
11	X	X						51							
12	X	X						52							
13	X	X						53							
14	X	X						54							
15	X	X						55							
16	X	X						56							
17	X	X						57							
18	X	X						58							
19	X	X						59							
20	X	X						60							
21	X	X						61							
22	X	X						62							
23	X	X						63							
24	X	X						64							
25	X	X						65							
26	X	X						66							
27	X	X						67							
28	X	X						68							
29	X	X						69							
30	X	X						70							
31	X	X						71							
32	X	X						72							
33	X	X						73							
34	X	X						74							
35	X	X						75							
36								76							
37								77							
38								78							
39								79							
40								80							

Screw Compressor Standard Inspection Procedures
Document No. SCSD-010-13
Performance Test, Mechanical Running Test, Noise and Vibration Test

13	2023/01/17	Sakaguchi	Iisaka	Muta	Review and revised
12	2022/08/01	Sakaguchi	Iisaka	Muta	Review and revised
11	2022/05/23	Sakaguchi	Iisaka	Muta	Review and revised i series add
10	2020/06/16	Sakaguchi	Kato	Koizumi	400XXL added
09	2020/04/28	Saka Sakaguchi	Koizumi	Kato	Review and revised [6.2.3 Noise item]
08	2017/11/22	Suzukawa	Sasaki	Kawasaki	Review and revised
07	2017/03/30	Suzukawa	Sasaki	Kawasaki	Review and revised
06	2016/05/18	Iisaka	Sasaki	Kawasaki	Review and revised
05	2016/01/01	Suzukawa	Sasaki	Kawasaki	Review and revised
04	2015/02/17	Suzukawa	Sasaki	Kawasaki	Review and revised
03	2014/03/01	Suzukawa	Sasaki	Sakaguchi	Review and revised
02	2012/05/01	Suzukawa	Sasaki	Shozu	J series added
01	2011/07/01	Sasaki	Ikehara	Shozu	Review and revised
00	06/06/09	Ikehara	Amada	Koizumi	Newly created
Revision	Date	Created by	confirmed by	Approved by	Description

1. Scope

These procedures apply to the performance test, mechanical running test, vibration and noise tests of MYCOM screw compressors at the compressor manufacturing division of Mayekawa's Moriya plant, using air test equipment. The test fluid should be air. For equipment required for these tests such as couplings, motors, oil separators, cooler and measurement equipment, the test benches at the plant are used.

2. Applicable Models

	Model	Type	Manufactured from	Remarks
1	UD/G series	125*UD/*G~320*UD/*U	1970	Single stage compressor (side discharge, downward discharge)
2	SCV series	160V** ~ 250V**	1991	Single stage compressor (side discharge, downward discharge)
3	SCV series	320V**	1998	Single stage compressor (side discharge, downward discharge)
4	VR series	160V*R	1996	Single stage compressor (with gear box)
5	Compound type two-stage compressor series	1610**C ~ 3225**C	1975	
6	Compound type two-stage compressor series	4032**C	2001	
7	UD series	400*UD	2002	Single stage compressor (side discharge)
8	J series	170J*, 220J*280J*	2011	Single stage compressor
9	i series	i125*, i160*	2002	Single stage compressor

3. Tests

- 1) Performance test
 - capacity
 - brake horse power
- 2) Mechanical running test
- 3) Vibration and noise tests

4. Performance Test

[Capacity]

4.1 Purpose

This test is carried out to determine that the volume flow rate of suction gas at the inlet of the compressor and the brake horse power meet the criteria.

4.2 Measuring Method/Equipment and Test Conditions

In accordance with the JIS standard Measurement of Fluid Flow by Means of Orifice Plates, Nozzles And Venturi Tubes (JIS Z 8762:2007), we measure pressures and temperatures required for calculating the volume rate of flows from ① to ⑬ or ① to ⑮ shown in the Figure-1 or 2: Test Equipment and Measurement Points using pressure gauge, manometer and thermometers. Performance measurement will be done during the mechanical running test.

The test fluid used for performance test and mechanical running test should be air.


Testing is conducted under standard testing conditions (refer to Table-1). Motor revolution is controlled by 2950-3000 rpm (2P) or 1450-1500rpm (4P). Gears and the like are not used to increase the speed of the compressor.

The load operating conditions should be 100%, that is, the slide valve opening should be 100%.

The standard temperature of compressor lubrication oil should be 30°C to 50°C. The standard pressure of compressor lubrication oil on the discharge side is 0.2 to 0.3MPaG higher than the discharge pressure. When discharge pressure is 0.7 MPaG, then (with a tolerance of between 0.2 to 0.3) the standard pressure should be 0.9 to 1.0 MPaG.


Measurement equipment differs according to the test bench required for each compressor type. Refer to Appendix Table-2: Measurement Equipment List for details as reference.

Figure-1 : Test Equipment and Measurement Points [Single stage compressor]

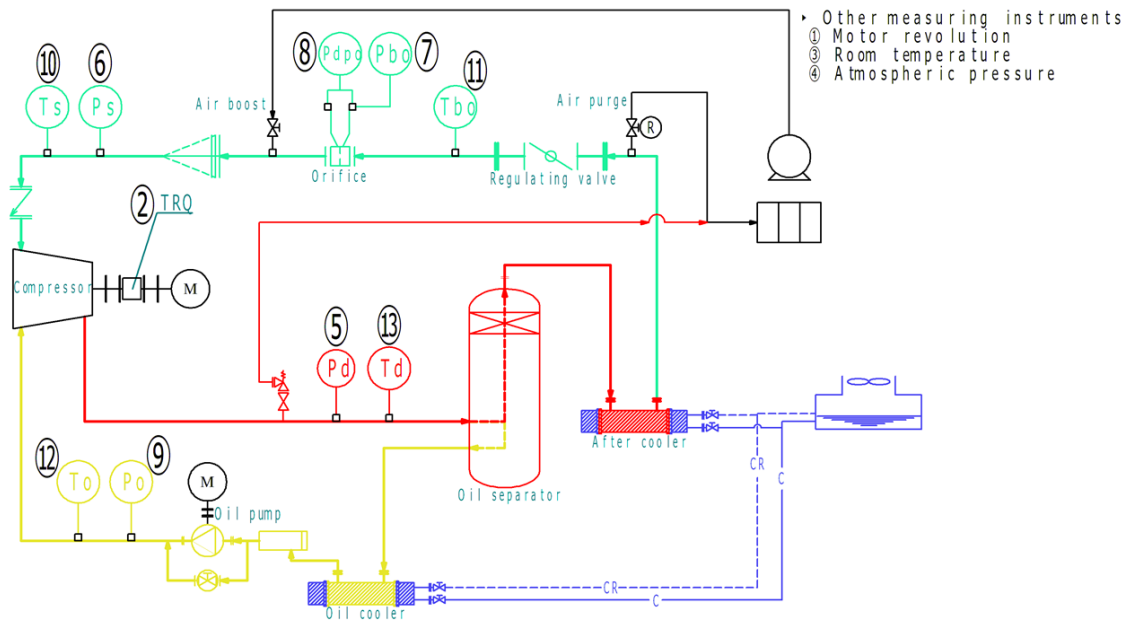

① Motor revolution	(min-1)	⑧ Pressure differential at orifice	(kPa.G)
② Torque	(Nm)	⑨ Oil pressure	(MPa.G)
③ Room temperature	(°C)	⑩ Suction temperature	(°C)
④ Atmospheric pressure	(hPa)	⑪ Temperature before orifice	(°C)
⑤ Discharge pressure	(MPa.G)	⑫ Oil temperature	(°C)
⑥ Suction pressure	(MPa.G)	⑬ Discharge temperature	(°C)
⑦ Pressure before orifice	(kPa.G)		

Figure-2 : Test Equipment and Measurement Points [Compound type compressor]

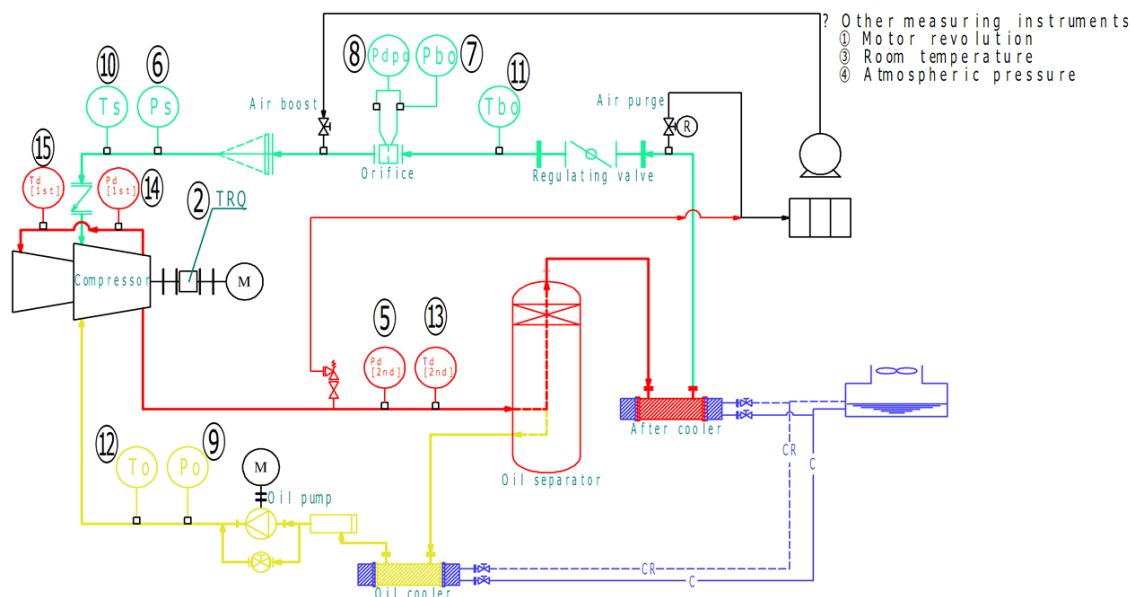

① Motor revolution	(min-1)	⑨ Oil pressure	(MPa.G)
② Torque	(Nm)	⑩ Suction temperature	(°C)
③ Room temperature	(°C)	⑪ Temperature before orifice	(°C)
④ Atmospheric pressure	(hPa)	⑫ Oil temperature	(°C)
⑤ Discharge pressure [2 nd]	(MPa.G)	⑬ Discharge temperature [2 nd]	(°C)
⑥ Suction pressure	(MPa.G)	⑭ Discharge pressure [1 st]	(MPa.G)
⑦ Pressure before orifice	(kPa.G)	⑮ Discharge temperature [1 st]	(°C)
⑧ Pressure differential at orifice	(kPa.G)		

Unit : MPaG

Code	Classification	Suction pressure	Discharge pressure
F	Single stage type	0.00	0.30
J		0.00	0.30
K		0.00	0.30
L		0.00	0.30
M		0.00	0.50
H		0.00	0.70
C	Compound type	0.00	0.70
B	Booster type	0.00	0.30
DD	Slide Valve with groove	0.00	0.30

Note) Vi : design volume ratio, * J series

[Table-1:Standard pressure conditions]

4.3. Calculation of the Volume Flow Rate of Suction Gas

Calculate the volume ratio of suction gas flow before orifice (Q_a) from formula (1) below using orifice differential pressure, pressure before orifice and temperature.

$$Q_a = \varepsilon \cdot \alpha \cdot \pi / 4 (dt \times 10^{-3})^2 \sqrt{2 \cdot \Delta H \times 10^6 \times V_0} \times 3600 \cdot \cdot (1)$$

Q_a	the volume flow rate of suction gas before orifice	(m^3/h)
ε	expansibility factor	(-)
α	flow coefficient	(-)
dt	Diameter of orifice	(mm)
ΔH	Differential pressure around orifice plate	(MPa)
V_0	Gas specific volume before orifice	(m^3/kg)

Calculate the volume ratio of flow of suction gas at compressor inlet (Q_s) from formula (2) using gas volume ratio before the orifice and at the suction inlet.

$$Q_s = Q_a \times \frac{V_s}{V_0} \cdot \cdot \cdot \cdot (2)$$

Q_s	the volume flow rate of suction gas at the compressor inlet	(m^3/h)
Q_a	the volume flow rate of suction gas before orifice	(m^3/h)
V_s	Gas specific volume at compressor inlet	(m^3/kg)
V_0	Gas specific volume before orifice	(m^3/kg)

4.3.1 Acceptance Criteria

As mentioned above, the measured value of the suction gas volume flow rate obtained from the preceding 4.3 shall be acceptable at least 95% of the standard suction gas volume flow rate. The suction gas standard volume flow rate is calculated by an approximate formula based on the past experiences and measured values. The suction gas standard volume flow rate shall be corrected by the measured value (rotational speed, atmospheric pressure, etc.) on the day of the test.

4.3.2 Records

The test results are recorded in Appendix-1: Screw Compressor Test Records.

[Break Horse Power]

4.4 Measuring Break Horse Power

4.4.1 Purpose

Torque and motor revolutions are measured to calculate the break horse power.

4.4.2. Measurement Method/Equipment and Conditions

Measurement conditions are the same as for the capacity test.
 Torque is measured using the torque meter mounted on the rotational axis.
 Motor revolutions are measured using a tachometer.

4.4.3. Break horse power is calculated from the formula (3) below using the reading value of the torque meter.

$$kW = \frac{1}{1000} \times \frac{2\pi}{60} \times \text{RPM} \times \text{TRQ} \dots\dots(3)$$

kW	break horse power	(kW)
RPM	motor revolution	(min ⁻¹)
TRQ	torque	(Nm)

4.4.4. Acceptance Criteria

The actual values of brake horse power obtained from the above clause 4.4.3 shall be acceptable if they are 105% or less of the power standard value. The power standard value is calculated by an approximate formula based on the past experienced and measured values. The power standard value shall be corrected by the measured value (rotational speed, atmospheric pressure, etc.) on the day of the test.

4.4.5. Records

The test results are recorded in Appendix-1: Screw Compressor Test Records.

5. Mechanical Running Test

5.1 Purpose

After compressor operation stabilizes*, perform a two hour/four hour running test to check for faults by measuring the surface temperature of the compressor.

*Stable operation state means the change of lubrication oil temperature is within 3 degrees in 30minutes while meeting the test conditions stipulated in paragraph 4.2 and Table-1, 30minutes after start-up.

5.2 Measurement Method/Equipment and Conditions

In 30minutes after start-up when the compressor operation reaches stable state while maintaining the test conditions stipulated in paragraph 4.2 and Table-1, measure the surface temperature at each point shown in Figure-3 and Figure-4 and check the lubrication, vibration, noise and for other abnormalities.

The surface temperature measurement locations are shown in Figures-3 and 4. Refer to the Annex 1 for API 682 compliant mechanical seals.

Figure-3: Single Stage Compressor

- P1. Rotor casing
- P2. Bearing head
- P3. Shaft seal
- P4. Oil header (lubrication oil supply temperature)


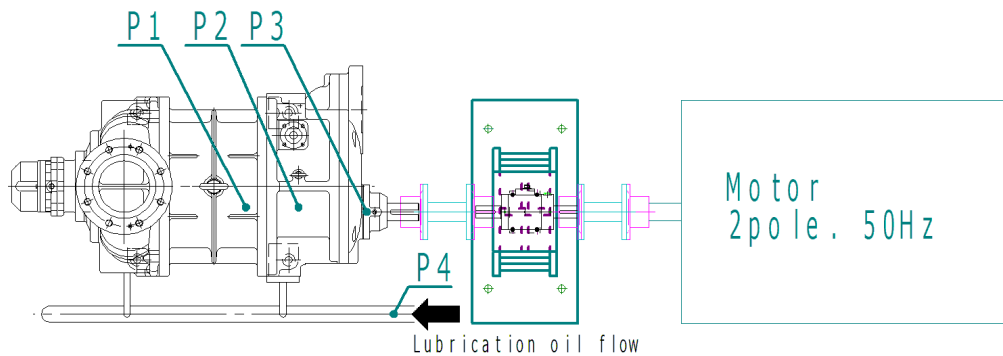


Figure-4: Compound Type Compressor

- P1. Low side rotor casing
- P2. Low side bearing head
- P3. Shaft seal
- P4. High side rotor casing
- P5. High side bearing head
- P6. Oil header (lubrication oil supply temperature)

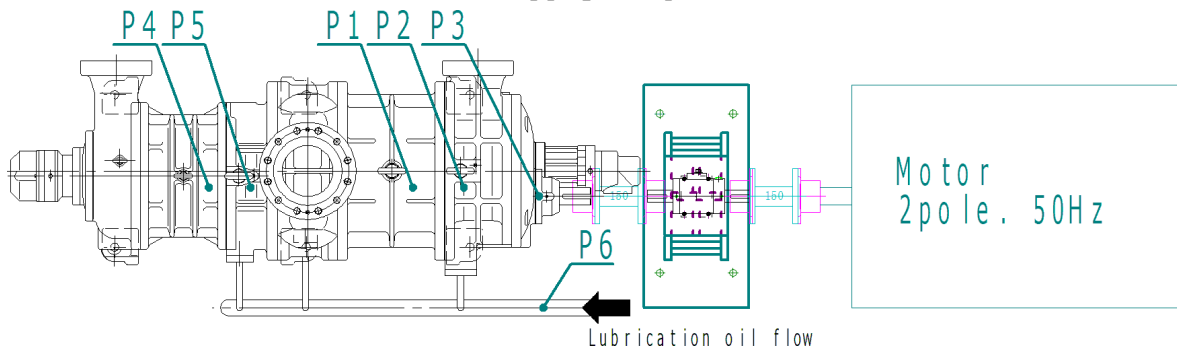

5.3 Acceptance Criteria

Measurement values that do not exceed the values indicated in Table-2 are accepted.

Single stage compressor		Compound type two stage compressor		Allowable value
P1	Rotor casing	P1	Low side rotor casing	Lubrication oil temperature +35°C
P2	Bearing head	P2	Low side bearing head	Lubrication oil temperature +35°C
P3	Shaft seal	P3	Shaft seal	Lubrication oil temperature +20°C
		P4	High side rotor casing	Lubrication oil temperature +35°C
		P5	High side bearing head	Lubrication oil temperature +35°C

Table-2 Surface Temperature Criteria

5.4 Records

The test results are recorded in Appendix 1: Screw Compressor Test Records.

6. Vibration and Noise Tests

6.1 Purpose

Noise and vibration tests are carried out during mechanical running test to check whether the compressor's noise and vibration are within the standard shipping values or not.

6.2 Measurement Method

6.2.1 Vibration

The amplitude of vibration is measured with a general purpose vibrometer (frequency analysis of the vibration is not performed.)

6.2.2 Measurement Method

Measurement points are shown in Figures-5 and Figure-6. Using a magnetic pickup, amplitudes are measured at each point (V, H, A for single stage compressors and VL, HL, AL, VH, HH, AH for compound type compressors).

6.2.3 Noise

Noise is measured using a sound level meter as specified in the standard JIS C 1509(2017) Electroacoustics-Sound level meters- in accordance with JIS B 8346 (1991) Fans, blowers and compressors - Determination of A-weighted sound pressure level.

When the difference between the actual measurement and the background noise value is less than 10 dB, the actual measurement value should be corrected according to JIS Z 8731 (2019) Acoustics -- Description and measurement of environmental noise.

6.2.4 Measurement Method

Noise measurement points are shown as P-point in Figures-5 and 6.

Figure-5 : Single Stage Compressor


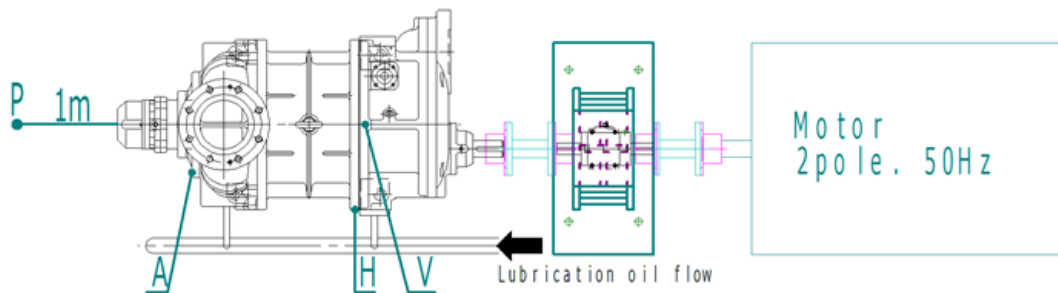


Figure-6 : Compound Type Compressor

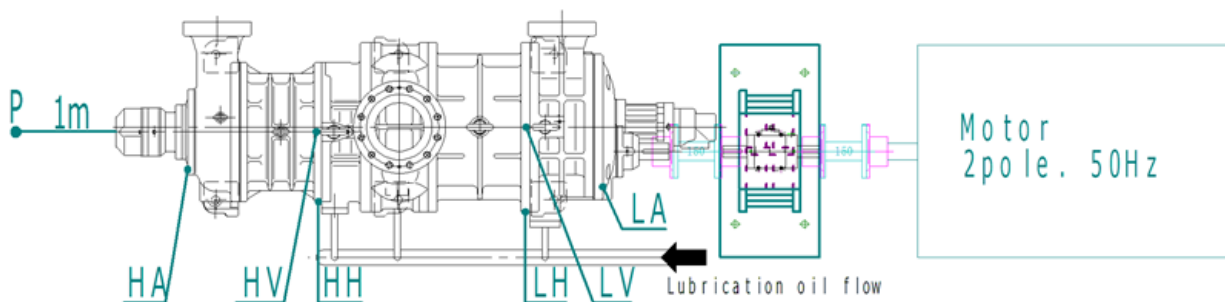

6.3 Acceptance Criteria


Compressors with results not exceeding the values shown in Table 1 *Noise and Vibration Shipment Standards for Screw Compressors* are accepted.

6.4 Records


The test results are recorded in Appendix-1: Screw Compressor Test Records.

Appendix Table 1

Noise and Vibration Shipment Standards for Screw Compressors

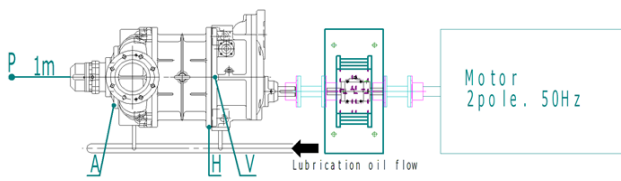

Single stage compressor

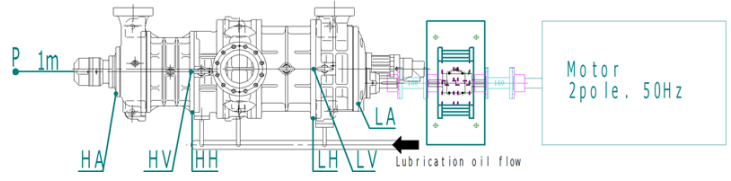

Compound type compressor

[Noise]

Compressor type	Acceptance value dB(A)
125SUD, i125S	84
125LUD, i125L	84
160SUD, 160VSD, i160S	84
160MUD, 160VMD, i160M	84
160LUD, 160VLD, i160L	85
200SUD, 200VSD	86
200MUD, 200VMD	87
200LUD, 200VLD	88
250SUD, 250VSD	88
250MUD, 250VMD	90
250LUD, 250VLD	90
250VLLD	92
320SUD, 320VSD	95
320MUD, 320VMD	97
320LUD, 320VLD	98
320LLUD	103
400SUD	103
400MUD	104
400LUD	105
400LLUD	106
400XLUD	107
400XXLUD	108
170JS	81
170JM	84
170JL	86
220JS	86
220JM	86
220JL	89
280JS	88
280JM	90
280JL	92

Compressor type	Acceptance value dB(A)
1610C	84
1612C	86
1612C 2P 増速	90
1612C 4P 増速	88
2016C	87
2520C	92
3225C	98
4025C	105
4032C	108
160VSR	87
160VLR	88
200VSR	89
200VLR	91
250VSR	91
250VLR	93

Vibration(Frequency range:10-1000 Hz)

Values in gray column are applicable only when API619 is compliant

Type	Measurement points	Allowance value for amplitude μm (half amplitude peak)	Allowance value for velocity mm/s (RMS)
Single stage Compressors	V	20	8
	H	20	8
	A	20	8
Compound type two stage compressors	VH	20	8
	HH	20	8
	AH	20	8
	VL	20	8
	HL	20	8
	AL	20	8
	V	20	8
H	20	8	

* This criteria is acceptable for the downward discharge type compressors

Measuring instrument list

* General information ;

Item No.	: -
Report No.	:
Type of compressor	:
Date of test	:
Model	:
Serial No.	:
Inspection items	: Internal test
Tested at	: MAYEKAWA MFG. CO.,LTD. MORIYA PLANT 2000, Tatsuzawa Moriya-city, Ibaraki-pref., 302-0118, Japan

SURVEYOR

Sample

Name	Used place	Registration No.	Type	Term of validity
U tube manometer	7.Pressure Before Orifice	AA-MM007	PM12-243	September,2023
	6.Suction Pressure	AA-MM008	PM12-231	September,2023
	8.Differential Pressure Across Orifice	AA-MM009	PM12-231	September,2023
Bourdon tube pressure gauge	5.Discharge Pressure	AA-16808	DU1/2 x 150mm x 1.6MPa	July,2023
	9.Oil Pressure	AA-16814	DU1/2 x 150mm x 1.6MPa	July,2023
Strain gauge type torque meter	2.Running Torque	AA-TQ015	TMNR-10KNM	July,2025
Aneroid atmospheric meter	3-4.Atmospheric Pressure	AA-AK003	930~1070hPa	January,2023
Rotating meter	1.Rotational speed	AA-RP006	HT-4200	August,2025
Noise meter		AA-SN008	NL-27	March,2023
Vibration meter		AA-SD004	VM-83	June,2025
Bar type thermometer	10.Suction Temperature	AA-On349	Alcohol temperature gauge	March,2023
	13.Discharge Temperature	AA-On324		April,2023
	11.Temperature Before Orifice	AA-On358		April,2023
	12.Oil Temperature	AA-On021		April,2023
	P5.Oil Temperature (Seal)	AA-On315		April,2023
Bar type thermometer	Rotor Casing [P1]	AA-On033	Alcohol temperature gauge	April,2023
	Bearing Head [P2]	AA-On040		June,2023
	Shaft Seal[Inner machine side] [P3]	AA-On321		December,2022
	Shaft Seal [Atmosphere side][P4]	AA-On041		June,2023
Test equipment	No.7		6300V x 2100KW x 2P x 4000rpm	-

SAMPLE

[Appendix 1 : Screw Compressor Test Records 1/2]



Screw compressor test record

* General information ;

Item No. : -
Report No. :
Type of compressor : Screw compressor
Date of test :
Model :
Serial No. :
Test fluid : Air
Orifice No. :
Time :
Inspection items : Internal test

SURVEYOR

1. Revolution		[min-1]
2. Running torque	Measured value	[V]
	Converted value	[N·m]
3. Room temperature		[°C]
4. Atmospheric pressure		[hPa]
5. Discharge pressure		[MPa]
6. Suction pressure	L () [kPa]	[kPa]
	R () [kPa]	
7. Pressure before orifice	L () [kPa]	[kPa]
	R () [kPa]	
8. Pressure difference at orifice	L () [kPa]	[kPa]
	R () [kPa]	
9. Oil pressure		[MPa]
10. Suction temperature		[°C]
11. Temperature before orifice		[°C]
12. Oil temperature		[°C]
13. Discharge temperature		[°C]

Noise [dB](A)
Background Noise [dB](A)

* Test results;

Temp. of rotor casing	P 1	[°C]
Temp. of bearing head	P 2	[°C]
Temp. of shaft seal [Inner machine side]	P 3	[°C]
Temp. of shaft seal [Atmosphere side]	P 4	[°C]
Temp. of seal lubrication	P 5	[°C]
Test of vibration	V	[μm]
	H	[μm]
	A	[μm]

Approved by : _____

Checked by : _____



Screw Compressor test results

* General information ;

Item No.	:	-
Report No.	:	
Type of compressor	:	
Date of test	:	
Model	:	
Serial No.	:	
Test fluid	:	Air
Orifice No.	:	
Time	:	
Inspection items	:	Internal test

SURVEYOR

Sample

* Performance test ;

	Standard	Actual	Judgment	Criteria
Capacity [m3/h] :		(%)	Accepted	95% and more
Kilowatts [kW] :		(%)	Accepted	105% or less

* Mechanical running test ;

	Allowable Maximum	Actual	Judgment
Temp. of rotor casing	P 1 [°C] :	≧	Accepted
Temp. of bearing head	P 2 [°C] :	≧	Accepted
Temp. of shaft seal [Inner machine side]	P 3 [°C] :	≧	Accepted
Temp. of shaft seal [Atmosphere side]	P 4 [°C] :	≧	Accepted
Temp. of seal lubrication	P 5 [°C] :	30~50	Accepted

* Vibration and Noise tests ;

	Allowable Maximum	Actual	Judgment
Noise [dB](A) :	≧		Accepted
(Frequency range : 10 - 1000Hz)			
Vibration [μm] V :	20	≧	Accepted
H :	20	≧	Accepted
A :	20	≧	Accepted

Approved by : _____

Checked by : _____

Screw Compressor Standard Inspection Procedures

Document No. : SCSD-007-08

Screw Rotor Dynamic Balance Test

Moriya Plant, Mayekawa Mfg. Co., Ltd.

Revision	Date	Created by	Confirmed by	Approved by	Description
08	2021/12/09	Saka	Kato	Koizumi	Revised the reference value
07	2020/06/29	Sakaguchi	kato	Koizumi	400XXL added
06	2017/07/12	Iisaka	Sasaki	Kawasaki	Changed of equipment manufacturer company name
05	2016/06/10	Iisaka	Sasaki	Kawasaki	W series added
04	2014/04/01	Suzukawa	Sasaki	Sakaguchi	Review and revised
03	2013/05/01	Suzukawa	Sasaki	Shozu	Review and revised
02	2012/05/01	Suzukawa	Sasaki	Shozu	J series added
01	2011/07/01	Sasaki	Ikehara	Shozu	Review and revised
00	06/06/05	Ikehara	Amada	Koizumi	Newly created

Screw Rotor Dynamic Balance Test

1. Scope

Rotor dynamic balance test is carried out to check whether the compressor's rotor dynamic balance is within the standard value of the standard "Rotating machines - Balance quality requirement of rigid rotors" (JIS B 0905-1992).

2. Dynamic Balance Test

2.1 Method of Dynamic Balance Test


Rotor dynamic balance is measured at two points on each rotor using a screw rotor balancing machine.

Measuring points (see the figures below)


Male rotor At points A and B

Female rotor At points C and D

[Male rotor]

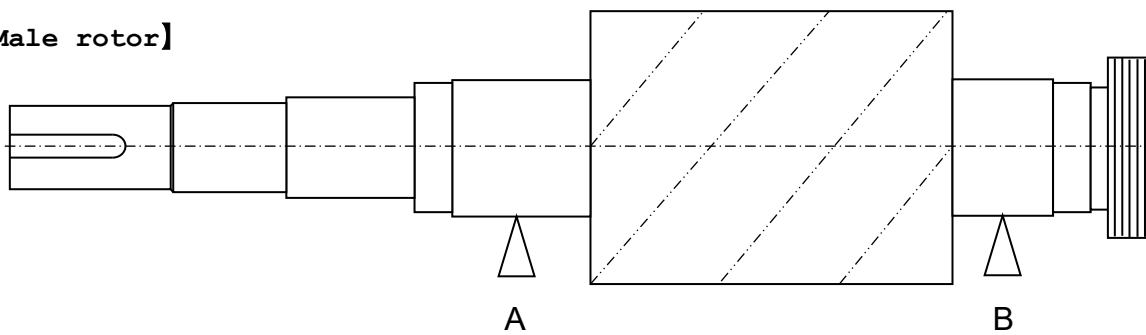

[Female rotor]

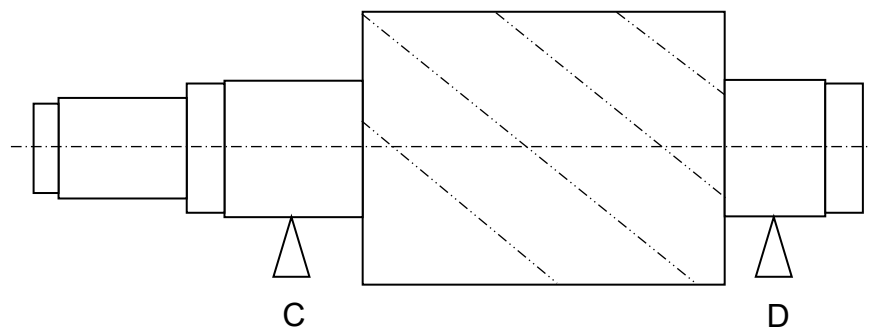

2.2 Measuring equipment

Manufacturer	Measuring equipment	Model
NAGAHAMA SEISAKUSHO LTD.,	Dynamic balancing machine	H40U H20NB

3. Acceptance Criteria

The acceptance criteria is as per JIS B 0905 Class G2.5 or Class 1.0 and the measured values must not exceed these criteria. Refer to the following tables as the standard values differ from rotor materials.

Rotor Material	<input type="checkbox"/> FCD600	<input type="checkbox"/> SFCM930S	<input type="checkbox"/> SFCM740S
Balance class	<input type="checkbox"/> Class G2.5	<input type="checkbox"/> Class G1.0	

3.1.1 JIS G 5502 : FCD600 (Ductile Iron) JIS B 0905 Class G2.5 < Single stage compressor >

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
125S	0.7	3.7	4500	0.8	4.2	3000	1265
125L	0.9	4.8	4500	1.0	5.6	3000	1265
160S	1.0	7.6	4500	1.2	8.8	3000	1265
160M	1.2	8.8	4500	1.4	10.3	3000	1265
160L	1.4	10.0	4500	1.6	11.7	3000	1265
200S	1.6	14.2	4500	1.8	16.6	3000	1265
200M	1.8	16.6	4500	2.2	19.4	3000	1265
200L	2.1	18.8	4500	2.5	22.2	3000	1265
250S	2.4	26.8	4500	2.9	31.7	3000	750
250M	2.9	31.4	4500	3.4	37.4	3000	750
250L	3.3	35.8	4500	3.9	42.7	3000	750
250LL	4.7	51.8	3600	5.7	62.8	2400	750
320S	4.9	68.1	3600	5.8	80.6	2400	430
320M	5.7	79.3	3600	6.7	94.3	2400	430
320L	6.5	90.4	3600	7.7	107.8	2400	430
320LL	7.5	104.3	3600	9.0	126.3	2400	430
400S	8.3	145.6	3600	9.9	173.2	2400	430
400M	9.7	169.2	3600	11.5	201.9	2400	430
400L	10.9	191.4	3600	13.1	228.9	2400	430
400LL	12.4	216.4	3600	14.8	259.4	2400	430
400XL	13.6	237.3	3600	16.3	284.9	2400	430
400XXL	14.9	261.1	3600	17.9	313.9	2400	430
160WS	1.1	7.7	4500	1.2	9.0	3000	1265
160WM	1.2	8.9	4500	1.4	10.4	3000	1265
160WL	1.4	10.1	4500	1.6	11.8	3000	1265
200WS	1.6	14.5	4500	1.9	16.8	3000	1265
200WM	1.9	16.8	4500	2.2	19.6	3000	1265
200WL	2.1	19.1	4500	2.5	22.4	3000	1265
250WS	2.5	27.5	4500	3.0	33.3	3000	750
250WM	2.9	32.1	4500	3.5	38.9	3000	750
250WL	3.3	36.5	4500	4.0	44.2	3000	750
320WS	5.0	69.7	3600	6.0	84.2	2400	430
320WM	5.8	80.9	3600	7.0	97.8	2400	430
320WL	6.6	92.0	3600	7.9	111.3	2400	430

Continued on the following page

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
170JS	1.3	9.8	4500	1.0	6.0	3750	1265
170JM	1.6	11.4	4500	1.1	7.0	3750	1265
170JL	1.9	13.5	4500	1.4	8.6	3750	1265
220JS	2.5	23.3	4500	1.8	14.6	3750	1265
220JM	2.9	27.6	4500	2.1	17.5	3750	1265
220JL	3.5	32.9	4500	2.6	21.3	3750	1265
280JS	5.2	64.3	3600	3.8	40.2	3000	750
280JM	6.1	75.6	3600	4.5	48.1	3000	750
280JL	7.3	90.2	3600	5.6	58.9	3000	750
i125S	0.6	3.5	4500	0.7	3.7	3000	1265
i125L	1.1	5.8	3550	1.2	6.5	2367	1265
i160S	0.9	6.8	4500	1.1	8.0	3000	1265
i160M	1.4	10.2	3550	1.6	12.0	2367	1265
i160L	1.6	11.8	3550	1.9	13.8	2367	1265

3.1.2 JIS G 5502 : FCD600 (Ductile Iron) JIS B 0905 Class G1.0 < Single stage compressor >

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
160S	0.4	3.0	4500	0.5	3.5	3000	1265
160M	0.5	3.5	4500	0.6	4.1	3000	1265
160L	0.5	4.0	4500	0.6	4.7	3000	1265
200S	0.6	5.7	4500	0.7	6.6	3000	1265
200M	0.7	6.6	4500	0.9	7.8	3000	1265
200L	0.8	7.5	4500	1.0	8.9	3000	1265
250S	1.0	10.7	4500	1.2	12.7	3000	750
250M	1.1	12.6	4500	1.4	14.9	3000	750
250L	1.3	14.3	4500	1.6	17.1	3000	750
250LL	1.9	20.7	3600	2.3	25.1	2400	750
320S	1.9	27.2	3600	2.3	32.3	2400	430
320M	2.3	31.7	3600	2.7	37.7	2400	430
320L	2.6	36.1	3600	3.1	43.1	2400	430
320LL	3.0	41.7	3600	3.6	50.5	2400	430

Continued on the following page

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
400S	3.3	58.2	3600	4.0	69.3	2400	430
400M	3.9	67.7	3600	4.6	80.8	2400	430
400L	4.4	76.5	3600	5.2	91.6	2400	430
400LL	4.9	86.6	3600	5.9	103.8	2400	430
400XL	5.4	94.9	3600	6.5	114.0	2400	430
400XXL	6.0	104.4	3600	7.2	125.6	2400	430
160WS	0.4	3.1	4500	0.5	3.6	3000	1265
160WM	0.5	3.6	4500	0.6	4.2	3000	1265
160WL	0.6	4.0	4500	0.6	4.7	3000	1265
200WS	0.6	5.8	4500	0.7	6.7	3000	1265
200WM	0.7	6.7	4500	0.9	7.8	3000	1265
200WL	0.8	7.6	4500	1.0	8.9	3000	1265
250WS	1.0	11.0	4500	1.2	13.3	3000	750
250WM	1.2	12.8	4500	1.4	15.6	3000	750
250WL	1.3	14.6	4500	1.6	17.7	3000	750
320WS	2.0	27.9	3600	2.4	33.7	2400	430
320WM	2.3	32.4	3600	2.8	39.1	2400	430
320WL	2.6	36.8	3600	3.2	44.5	2400	430

3.1.3 JIS G 3221 : SFM930S, SFM740S (Forged steel) JIS B 0905 Class G2.5

< Single stage compressor >

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
125S	0.7	4.1	4500	0.8	4.6	3000	1265
125L	1.0	5.3	4500	1.1	6.2	3000	1265
160S	1.1	8.4	4500	1.3	9.7	3000	1265
160M	1.3	9.7	4500	1.6	11.3	3000	1265
160L	1.5	11.0	4500	1.8	12.9	3000	1265
200S	1.7	15.7	4500	2.0	18.3	3000	1265
200M	2.0	18.3	4500	2.4	21.4	3000	1265
200L	2.3	20.8	4500	2.7	24.5	3000	1265
250S	2.7	29.6	4500	3.2	35.0	3000	750
250M	3.2	34.7	4500	3.7	41.2	3000	750
250L	3.6	39.5	4500	4.3	47.1	3000	750
250LL	5.2	57.1	3600	6.3	69.3	2400	750

Continued on the following page

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
320S	5.4	75.1	3600	6.4	88.9	2400	430
320M	6.2	87.5	3600	7.4	104.0	2400	430
320L	7.1	99.7	3600	8.5	118.8	2400	430
320LL	8.2	115.1	3600	10.0	139.3	2400	430
400S	9.2	160.6	3600	10.9	191.0	2400	430
400M	10.7	186.6	3600	12.7	222.7	2400	430
400L	12.1	211.0	3600	14.4	252.5	2400	430
400LL	13.6	238.6	3600	16.3	286.1	2400	430
400XL	15.0	261.7	3600	18.0	314.2	2400	430
400XXL	16.5	288.0	3600	19.8	346.2	2400	430
160WS	1.2	8.5	4500	1.4	9.9	3000	1265
160WM	1.3	9.8	4500	1.6	11.5	3000	1265
160WL	1.5	11.1	4500	1.8	13.0	3000	1265
200WS	1.8	16.0	4500	2.1	18.5	3000	1265
200WM	2.1	18.5	4500	2.4	21.6	3000	1265
200WL	2.3	21.0	4500	2.7	24.7	3000	1265
250WS	2.8	30.3	4500	3.3	36.7	3000	750
250WM	3.2	35.4	4500	3.9	42.9	3000	750
250WL	3.7	40.2	4500	4.4	48.8	3000	750
320WS	5.5	76.9	3600	6.6	92.8	2400	430
320WM	6.4	89.3	3600	7.7	107.9	2400	430
320WL	7.2	101.5	3600	8.8	122.7	2400	430

3.1.4 JIS G 3221 : SFMC930S, SFMC740S (Forged steel) JIS B 0905 Class G1.0

< Single stage compressor >

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
160S	0.5	3.4	4500	0.5	3.9	3000	1265
160M	0.5	3.9	4500	0.6	4.5	3000	1265
160L	0.6	4.4	4500	0.7	5.2	3000	1265
200S	0.7	6.3	4500	0.8	7.3	3000	1265
200M	0.8	7.3	4500	1.0	8.6	3000	1265
200L	0.9	8.3	4500	1.1	9.8	3000	1265

Continued on the following page

Model	Male rotor			Female rotor			Test speed
	Standard value		Max. speed	Standard value		Max. speed	
	g	g·cm	min-1	g	g·cm	min-1	min-1
250S	1.1	11.8	4500	1.3	14.0	3000	750
250M	1.3	13.9	4500	1.5	16.5	3000	750
250L	1.4	15.8	4500	1.7	18.8	3000	750
250LL	2.1	22.8	3600	2.5	27.7	2400	750
320S	2.1	30.0	3600	2.5	35.6	2400	430
320M	2.5	35.0	3600	3.0	41.6	2400	430
320L	2.8	39.9	3600	3.4	47.5	2400	430
320LL	3.3	46.0	3600	4.0	55.7	2400	430
400S	3.7	64.2	3600	4.4	76.4	2400	430
400M	4.3	74.6	3600	5.1	89.1	2400	430
400L	4.8	84.4	3600	5.8	101.0	2400	430
400LL	5.5	95.5	3600	6.5	114.4	2400	430
400XL	6.0	104.7	3600	7.2	125.7	2400	430
400XXL	6.6	115.2	3600	7.9	138.5	2400	430
160WS	0.5	3.4	4500	0.5	3.9	3000	1265
160WM	0.5	3.9	4500	0.6	4.6	3000	1265
160WL	0.6	4.5	4500	0.7	5.2	3000	1265
200WS	0.7	6.4	4500	0.8	7.4	3000	1265
200WM	0.8	7.4	4500	1.0	8.6	3000	1265
200WL	0.9	8.4	4500	1.1	9.9	3000	1265
250WS	1.1	12.1	4500	1.3	14.7	3000	750
250WM	1.3	14.2	4500	1.6	17.2	3000	750
250WL	1.5	16.1	4500	1.8	19.5	3000	750
320WS	2.2	30.8	3600	2.7	37.1	2400	430
320WM	2.6	35.7	3600	3.1	43.1	2400	430
320WL	2.9	40.6	3600	3.5	49.1	2400	430

3.2.1 JIS G 5502 : FCD600 (Ductile Iron) JIS B 0905 Class G2.5

< Compound two-stage compressor >

Model			Male rotor			Female rotor			Test speed
			Standard value		Max. speed	Standard		Max. speed	
			g	g·cm	min-1	g	g·cm	min-1	min-1
1610	low stage	S	1.1	7.9	4000	1.2	9.0	2667	1265
	high stage	L	0.7	2.9	4000	0.8	3.6	2667	1265

Continued on the following page

Model			Male rotor			Female rotor			Test speed
			Standard value		Max. speed	Standard value		Max. speed	
			g	g·cm	min-1	g	g·cm	min-1	min-1
1612	low stage *1 : Mounted on speed-up gear	S	1.0	7.1	4500	1.1	8.0	3000	1265
		M	1.1	8.3	4500	1.3	9.4	3000	1265
		L	1.3	9.5	4500	1.5	10.9	3000	1265
		L* ¹	1.3	9.6	4500	1.5	10.9	3000	1265
	high stage	S	0.6	3.2	4500	0.7	4.0	3000	1265
		L	0.8	4.3	4500	1.0	5.4	3000	1265
2016	low stage	S	1.7	15.3	4000	2.0	18.3	2667	1265
		M	2.0	17.9	4000	2.4	21.5	2667	1265
		L	2.3	20.5	4000	2.7	24.6	2667	1265
	high stage	S	1.0	7.6	4000	1.3	9.4	2667	1265
		M	1.2	8.9	4000	1.5	11.0	2667	1265
		L	1.4	10.2	4000	1.7	12.6	2667	1265
2520	low stage	S	3.0	32.8	3600	3.6	39.7	2400	750
		M	3.5	38.5	3600	4.2	46.7	2400	750
		L	4.0	44.0	3600	4.8	53.3	2400	750
	high stage	S	1.9	16.9	3600	2.3	20.7	2400	1265
		M	2.2	19.9	3600	2.7	24.3	2400	1265
		L	2.5	22.7	3600	3.1	27.7	2400	1265
		WS	1.9	17.3	3600	2.3	20.9	2400	1265
3225	low stage	S	4.7	66.3	3600	5.8	80.6	2400	430
		M	5.5	77.5	3600	6.7	94.3	2400	430
		L	6.3	88.6	3600	7.7	107.8	2400	430
		LL	7.2	100.9	3600	8.8	122.8	2400	430
	high stage	S	2.9	31.6	3600	3.5	38.9	2400	750
		M	3.4	37.4	3600	4.2	45.9	2400	750
		L	3.9	42.9	3600	4.8	52.6	2400	750
		WS	3.0	32.5	3600	3.7	40.8	2400	750
		WM	3.5	38.3	3600	4.4	47.9	2400	750
		WL	4.0	43.7	3600	5.0	54.5	2400	750

Continued on the following page

Model			Male rotor			Female rotor			Test speed
			Standard value		Max. speed	Standard		Max. speed	
			g	g·cm	min-1	g	g·cm	min-1	min-1
4032	low stage	S	8.1	142.4	3600	9.9	173.2	2400	430
		M	9.5	166.0	3600	11.5	201.9	2400	430
		L	10.8	188.2	3600	13.1	228.9	2400	430
		LL	12.2	213.2	3600	14.8	259.4	2400	430
		XL	13.4	234.1	3600	16.3	284.9	2400	430
	high stage	S	4.7	65.2	3600	5.8	80.6	2400	430
		M	5.5	76.4	3600	6.7	94.3	2400	430
		L	6.2	87.5	3600	7.7	107.8	2400	430
		LL	7.2	101.5	3600	9.0	126.3	2400	430
		WS	4.8	66.9	3600	6.0	84.2	2400	430
		WM	5.6	78.1	3600	7.0	97.8	2400	430
		WL	6.4	89.1	3600	7.9	111.3	2400	430

3.2.2 JIS G 5502 : FCD600 (Ductile Iron) JIS B 0905 Class G1.0

< Compound two-stage compressor >

Model			Male rotor			Female rotor			Test speed
			Standard value		Max. speed	Standard		Max. speed	
			g	g·cm	min-1	g	g·cm	min-1	min-1
1610	low stage	S	0.4	3.1	4000	0.5	3.6	2667	1265
1612	low stage *1 : Mounted on speed-up gear	S	0.4	2.8	4500	0.4	3.2	3000	1265
		M	0.5	3.3	4500	0.5	3.8	3000	1265
		L	0.5	3.8	4500	0.6	4.3	3000	1265
		L* ¹	0.5	3.9	4500	0.6	4.3	3000	1265
2016	low stage	S	0.7	6.1	4000	0.8	7.3	2667	1265
		M	0.8	7.2	4000	1.0	8.6	2667	1265
		L	0.9	8.2	4000	1.1	9.9	2667	1265
	high stage	S	0.4	3.0	4000	0.5	3.8	2667	1265
		M	0.5	3.6	4000	0.6	4.4	2667	1265
		L	0.6	4.1	4000	0.7	5.1	2667	1265

Continued on the following page

Model		Male rotor			Female rotor			Test speed	
		Standard value		Max. speed	Standard		Max. speed		
		g	g·cm	min-1	g	g·cm	min-1	min-1	
2520	low stage	S	1.2	13.1	3600	1.4	15.9	2400	750
		M	1.4	15.4	3600	1.7	18.7	2400	750
		L	1.6	17.6	3600	1.9	21.3	2400	750
	high stage	S	0.8	6.8	3600	0.9	8.3	2400	1265
		M	0.9	7.9	3600	1.1	9.7	2400	1265
		L	1.0	9.1	3600	1.2	11.1	2400	1265
		WS	0.8	6.9	3600	0.9	8.4	2400	1265
3225	low stage	S	1.9	26.5	3600	2.3	32.3	2400	430
		M	2.2	31.0	3600	2.7	37.7	2400	430
		L	2.5	35.4	3600	3.1	43.1	2400	430
		LL	2.9	40.4	3600	3.5	49.1	2400	430
	high stage	S	1.2	12.7	3600	1.4	15.6	2400	750
		M	1.4	15.0	3600	1.7	18.4	2400	750
		L	1.6	17.1	3600	1.9	21.0	2400	750
		WS	1.2	13.0	3600	1.5	16.3	2400	750
		WM	1.4	15.3	3600	1.7	19.2	2400	750
		WL	1.6	17.5	3600	2.0	21.8	2400	750
4032	low stage	S	3.3	57.0	3600	4.0	69.3	2400	430
		M	3.8	66.4	3600	4.6	80.8	2400	430
		L	4.3	75.3	3600	5.2	91.6	2400	430
		LL	4.9	85.3	3600	5.9	103.8	2400	430
		XL	5.4	93.7	3600	6.5	114.0	2400	430
	high stage	S	1.9	26.1	3600	2.3	32.3	2400	430
		M	2.2	30.6	3600	2.7	37.7	2400	430
		L	2.5	35.0	3600	3.1	43.1	2400	430
		LL	2.9	40.6	3600	3.6	50.5	2400	430
		WS	1.9	26.7	3600	2.4	33.7	2400	430
		WM	2.2	31.2	3600	2.8	39.1	2400	430
		WL	2.5	35.6	3600	3.2	44.5	2400	430

3.2.3 JIS G 3221 : SFCM930S, SFCM740S (Forged steel) JIS B 0905 Class G2.5

< Compound two-stage compressor >

Model			Male rotor			Female rotor			Test	
			Standard value		Max. speed	Standard		Max. speed	speed	
			g	g·cm	min-1	g	g·cm	min-1	min-1	
1610	low stage	S	1.2	8.7	4000	1.4	9.9	2667	1265	
	high stage	L	0.7	3.2	4000	0.9	3.9	2667	1265	
1612	low stage	S	1.1	7.8	4500	1.2	8.8	3000	1265	
		*1 : Mounted on speed-up gear	M	1.3	9.2	4500	1.4	10.4	3000	1265
		L	1.4	10.5	4500	1.6	12.0	3000	1265	
	high stage	L*1	1.5	10.6	4500	1.6	12.0	3000	1265	
		S	0.6	3.6	4500	0.8	4.4	3000	1265	
		L	0.9	4.8	4500	1.1	5.9	3000	1265	
2016	low stage	S	1.9	16.9	4000	2.2	20.2	2667	1265	
		M	2.2	19.8	4000	2.6	23.8	2667	1265	
		L	2.5	22.6	4000	3.0	27.2	2667	1265	
	high stage	S	1.1	8.4	4000	1.4	10.4	2667	1265	
		M	1.3	9.8	4000	1.7	12.2	2667	1265	
		L	1.5	11.3	4000	1.9	13.9	2667	1265	
2520	low stage	S	3.3	36.1	3600	4.0	43.7	2400	750	
		M	3.9	42.5	3600	4.7	51.5	2400	750	
		L	4.4	48.5	3600	5.3	58.8	2400	750	
	high stage	S	2.1	18.7	3600	2.5	22.9	2400	1265	
		M	2.4	21.9	3600	3.0	26.8	2400	1265	
		L	2.8	25.0	3600	3.4	30.6	2400	1265	
WS	2.1	19.1	3600	2.6	23.1	2400	1265			
3225	low stage	S	5.2	73.2	3600	6.4	88.9	2400	430	
		M	6.1	85.5	3600	7.4	104.0	2400	430	
		L	7.0	97.7	3600	8.5	118.8	2400	430	
		LL	8.0	111.3	3600	9.7	135.4	2400	430	
	high stage	S	3.2	34.9	3600	3.9	42.9	2400	750	
		M	3.8	41.3	3600	4.6	50.7	2400	750	
		L	4.3	47.3	3600	5.3	58.0	2400	750	
		WS	3.3	35.8	3600	4.1	45.0	2400	750	
		WM	3.8	42.2	3600	4.8	52.8	2400	750	
		WL	4.4	48.2	3600	5.5	60.1	2400	750	

Continued on the following page

Model			Male rotor			Female rotor			Test
			Standard value		Max. speed	Standard		Max. speed	speed
			g	g·cm	min-1	g	g·cm	min-1	min-1
4032	low stage	S	9.0	157.1	3600	10.9	191.0	2400	430
		M	10.5	183.1	3600	12.7	222.7	2400	430
		L	11.9	207.5	3600	14.4	252.5	2400	430
		LL	13.4	235.1	3600	16.3	286.1	2400	430
		XL	14.8	258.2	3600	18.0	314.2	2400	430
	high stage	S	5.1	71.9	3600	6.4	88.9	2400	430
		M	6.0	84.3	3600	7.4	104.0	2400	430
		L	6.9	96.5	3600	8.5	118.8	2400	430
		LL	8.0	111.9	3600	10.0	139.3	2400	430
		WS	5.3	73.7	3600	6.6	92.8	2400	430
		WM	6.1	86.1	3600	7.7	107.9	2400	430
		WL	7.0	98.3	3600	8.8	122.7	2400	430

3.2.4 JIS G 3221 : SFCM930S, SFCM740S (Forged steel) JIS B 0905 Class G1.0

< Compound two-stage compressor >

Model			Male rotor			Female rotor			Test
			Standard value		Max. speed	Standard		Max. speed	speed
			g	g·cm	min-1	g	g·cm	min-1	min-1
1610	low stage	S	0.5	3.5	4000	0.5	4.0	2667	1265
1612	low stage *1 : Mounted on speed-up gear	S	0.4	3.1	4500	0.5	3.5	3000	1265
		M	0.5	3.7	4500	0.6	4.2	3000	1265
		L	0.6	4.2	4500	0.7	4.8	3000	1265
		L*1	0.6	4.3	4500	0.7	4.8	3000	1265
2016	low stage	S	0.7	6.7	4000	0.9	8.1	2667	1265
		M	0.9	7.9	4000	1.1	9.5	2667	1265
		L	1.0	9.0	4000	1.2	10.9	2667	1265
	high stage	S	0.5	3.3	4000	0.6	4.2	2667	1265
		M	0.5	3.9	4000	0.7	4.9	2667	1265
		L	0.6	4.5	4000	0.8	5.6	2667	1265
2520	low stage	S	1.3	14.5	3600	1.6	17.5	2400	750
		M	1.5	17.0	3600	1.9	20.6	2400	750
		L	1.8	19.4	3600	2.1	23.5	2400	750
	high stage	S	0.8	7.5	3600	1.0	9.1	2400	1265
		M	1.0	8.8	3600	1.2	10.7	2400	1265
		L	1.1	10.0	3600	1.4	12.2	2400	1265
		WS	0.8	7.6	3600	1.0	9.2	2400	1265

Continued on the following page

Model		Male rotor			Female rotor			Test	
		Standard value		Max. speed	Standard		Max. speed	speed	
		g	g·cm	min-1	g	g·cm	min-1	min-1	
3225	low stage	S	2.1	29.3	3600	2.5	35.6	2400	430
		M	2.4	34.2	3600	3.0	41.6	2400	430
		L	2.8	39.1	3600	3.4	47.5	2400	430
		LL	3.2	44.5	3600	3.9	54.2	2400	430
	high stage	S	1.3	14.0	3600	1.6	17.2	2400	750
		M	1.5	16.5	3600	1.8	20.3	2400	750
		L	1.7	18.9	3600	2.1	23.2	2400	750
		WS	1.3	14.3	3600	1.6	18.0	2400	750
		WM	1.5	16.9	3600	1.9	21.1	2400	750
		WL	1.8	19.3	3600	2.2	24.0	2400	750
4032	low stage	S	3.6	62.8	3600	4.4	76.4	2400	430
		M	4.2	73.2	3600	5.1	89.1	2400	430
		L	4.7	83.0	3600	5.8	101.0	2400	430
		LL	5.4	94.1	3600	6.5	114.4	2400	430
		XL	5.9	103.3	3600	7.2	125.7	2400	430
	high stage	S	2.1	28.8	3600	2.5	35.6	2400	430
		M	2.4	33.7	3600	3.0	41.6	2400	430
		L	2.8	38.6	3600	3.4	47.5	2400	430
		LL	3.2	44.8	3600	4.0	55.7	2400	430
		WS	2.1	29.5	3600	2.7	37.1	2400	430
		WM	2.5	34.4	3600	3.1	43.1	2400	430
		WL	2.8	39.3	3600	3.5	49.1	2400	430

4. Records

The test results and judgment are recorded on Appendix-1: MALE/FEMALE ROTOR BALANCING TEST REPORT.



Item No. -

Report No. 0
Serial No. 0

Rotor Balancing Test Report

Model No.	Material	Test Speed	Correction Radius
0	0	0	0


Allowable Residual Unbalance value = $\frac{0 \times 9550}{3600} \times \frac{M}{2} \times \frac{1}{10}$ Class : G 0 (JIS B 9905)

Male Rotor Weight (M) : 0
Female Rotor Weight (W) : 0

Sample

MALE ROTOR


Rotor No.	Date
0	January 0, 1900

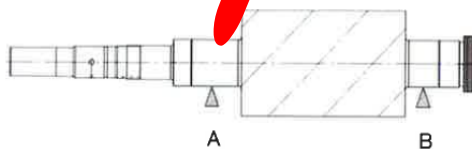

	Unbalanced Value at the Left Side (A)			Unbalanced Value at the Right Side (B)		
	(g)	Angle(°)	Value(g.cm)	(g)	Angle(°)	Value(g.cm)
Allowable Residual Unbalance	---	---	0	---	---	0
Before Adjustment	0.000	0	0.0	0.000	0	0.0
After Adjustment	---	---	---	---	---	---

FEMALE ROTOR

Rotor No.	Date
0	January 0, 1900

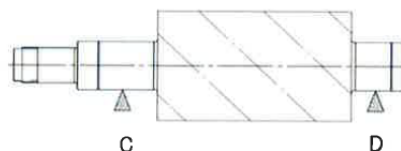

	Unbalanced Value at the Left Side (C)			Unbalanced Value at the Right Side (D)		
	(g)	Angle(°)	Value(g.cm)	(g)	Angle(°)	Value(g.cm)
Allowable Residual Unbalance	---	---	0	---	---	0
Before Adjustment	0.000	0	0.0	0.000	0	0.0
After Adjustment	---	---	---	---	---	---

Criteria Judgment : Accepted

SURVEYOR

Checked by : _____

Approved by : _____

Hydrostatic Test

1. Scope

This procedure defines the hydrostatic test performed at Moriya Plant, by the Compressor Manufacturing Division.

2. Hydrostatic test

2.1 Test Procedure

After assembling the compressor, it is filled with refrigeration oil.

The hydrostatic test is performed under the conditions shown in Table-1 for 30 minutes.

Table-1

Design pressure	2.6MPaG
Test pressure	3.9MPaG

Note: Two pressure gauges are used.

The test pressure is 1.5 times the design pressure.

The fluid used for the hydrostatic test is lubrication oil VG32 as standard.

3. Acceptance Criteria

The acceptance criterion is a visual inspection to ensure there are no distortions and leakages.

4. Records

The test results are recorded in Appendix-1:Hydrostatic & Pneumatic Tests Report.

[Appendix-1] **SAMPLE**

Hydrostatic & Pneumatic Tests Report

MYCOM

Report No. 0

Hydrostatic & Pneumatic Tests Report

Name of Client	
Type of Compressor	Screw Compressor
Compressor Model No.	0
Compressor Serial No.	0

TEST RECORD

Item	Design Pressure MPaG	Test Pressure MPaG	Used Fluid	Hold Time(Min)	Tested Date	Judgment
Hydrostatic test	2.6	3.9	OIL	30	March 13, 2012	Accepted
Pneumatic Pressure test	2.6	2.6	Air	30	December 31, 2012	Accepted

USED PRESSURE GAUGES

Item	Dia × Max. Pres. MPa.G	Manufacturer	Class(JIS)	No.
Hydrostatic test	φ 100 × 5.0	NAGANO	1.5	1, 2
Pneumatic Pressure test	φ 100 × 3.5	NAGANO	1.5	3, 4

Note :

MYCOM Control No.

AA-5.0100

AA-5.0103

3, AA-3.5001

4, AA-3.5002

SURVEYOR

Checked by : _____

Approved by : _____

MAYEKAWA MFG. CO.,LTD Moriya Plant

Screw Compressor Standard Inspection Procedures
Document No. SCSD-009-02
Gas Leak Test

Moriya Plant, Mayekawa Mfg. Co., Ltd.

02	2016/11/21	Iisaka	Sasaki	Kawasaki	Title changed
01	2011/07/01	Sasaki	Ikehara	Shozu	Review and revised
00	2006/6/5	Ikehara	Amada	Koizumi	Newly created
Revision	Date	Created by	confirmed by	Approved by	Description

Gas Leak Test

1. Scope

This procedure defines the gas leak test performed at Moriya Plant, by the Compressor Manufacturing Division.

2. Gas Leak Test

2.1 Test procedure

The gas leak test should be performed after the hydrostatic test.

The gas leak test is performed under the conditions shown in Table-1 by submerging the compressor under water for 30 minutes.

Table-1

Design pressure	2.6MPaG
Test pressure	2.6MPaG

Note: Two pressure gauges are used.

The test pressure is the same as the design pressure.

The gas used for the gas leak test is dry air as standard.

3. Acceptance Criteria

The acceptance criterion is a visual inspection to ensure no air bubbles are evident.

4. Records

The test results are recorded in Appendix-1:Hydrostatic & Gas Leak Tests Report.

SAMPLE

Appendix-1:Hydrostatic & Gas Leak Tests Report

MYCOM

Report No. 0

Hydrostatic & Gas Leak Test Report

Item No.	-
Type of Compressor	Screw Compressor
Compressor Model No.	0
Compressor Serial No.	0

TEST RECORD

Item	Design Pressure MPaG	Test Pressure MPaG	Used Fluid	Hold Time(Min)	Tested Date	Judgment
Hydrostatic test	2.6	3.9	OIL	30		Accepted
Gas Leak test	2.6	2.6	Air	30		Accepted

USED PRESSURE GAUGES

Item	Dia × Max. Pres. MPa.G	Manufacturer	Class(JIS)	No.
Hydrostatic test	φ 100 × 7.0	NAGANO	1.5	1, 2
Gas Leak test	φ 100 × 5.0	NAGANO	1.5	3, 4

Note :

No.	Registration No.	Terms of validity
1	AA-70105	Feb,2017
2	AA-70107	Feb,2017
3	AA-50005	Oct,2016
4	AA-50006	Oct,2016

SURVEYOR

Checked by : _____

Approved by : _____

MAYEKAWA MFG. CO.,LTD Moriya Plant